

1. **EU-TYPE EXAMINATION CERTIFICATE**
2. **Equipment or Protective System Intended for use in Potentially explosive atmospheres  
Directive 2014/34/EU**
3. EU-Type Examination Certificate Number: **EESF 18 ATEX 049X Issue 1**
4. Product: **Temperature sensor**  
Certified types: **WT-MI-302-6/.... -200/FEP-4J-KLA-EX**
5. Manufacturer: **Lapp Automaatio Oy**
6. Address: **Martinkyläntie 52, FI-01720 Vantaa, Finland**  
Additional manufacturing locations:  
**Lapp Connecto Oy, Varastokatu 10, FI-05800 Hyvinkää, Finland**
7. This product and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to.
8. Eurofins Expert Services Oy, Notified Body number 0537, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.  
  
The examination and test results are recorded in confidential report No. VTT-S-00736-07.
9. Compliance with the Essential Health and Safety Requirements has been assured by compliance with:  
**EN 60079-0 (2004)      EN 60079-7 (2003)      EN 61241-0 (2006)      EN 61241-1 (2004)**
10. If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.
11. This EU-Type Examination Certificate relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.
12. The marking of the product shall include the following:



II 2GD

**Ex e II T1–T6**  
**Ex tD A21 IP66 T 60 °C**  
**T<sub>amb</sub>: -40 °C...+125 °C/ +550 °C**

Espoo, 20.2.2019  
**Eurofins Expert Services Oy**



Tony Myllylä  
Expert




Jenni Hirvelä  
Expert



13. **Schedule**

14. **EU-Type Examination Certificate EESF 18 ATEX 049X Issue 1**

15. **Description of Product**

Temperature sensor, type WT-MI-302-6/... -200/FEP-4J-KLA-EX, consists of one Pt100-measuring element in a stainless steel protection tube. For the connection to external circuits the sensor is equipped with a fixed MgO-insulated cable with 4+PE conductors. The length (in mm) of a MgO-cable will be included in the type designation of the sensor.

16. **Report Number**

VTT-S-00736-07

17. **Specific Conditions of Use**

The temperature classification of the sensor (550 °C, T1 - T6) is determined by the ambient temperature of the installation place.

Maximum ambient temperature is 550 °C for the sensor head and 125 °C for the connection terminals of the sensor cable.

The connection of the sensor to external circuits shall be made according to the requirements of the connection place. Maximum voltage in the circuits to which the sensor is connected shall not exceed 60 V.

18. **Essential Health and Safety Requirements**

The Essential Health and Safety Requirements are covered by the standards listed at item 9.

19. **Drawings and Documents**


Construction drawing, component list and manufacturing instructions; drawing nr. 1068685 (rev 4), 5 pages.

20. **Certificate History**

Certificate	Date	Report No.	Change
VTT 07 ATEX 013X	23.1.2007	VTT-S-00736-07	Prime certificate.
EESF 18 ATEX 049X	05.12.2018	-	Name and address of the manufacturer has changed. The Certificate Number has change due to the name change of the Notified Body.
EESF 18 ATEX 049X Issue 1	20.2.2019	-	Document revision corrected.

Changes in the drawing are allowed only by the permission of the authorities who have granted the certificate  
 Muutokset sallittu vain sertifiikaatin myöntäjän luvalla


The drawing is a valid document only with signatures (Chkd. and Appd.)  
 Piirustus on pätevä dokumentti vain allekirjoitettuna (Tark. ja Hyv.)

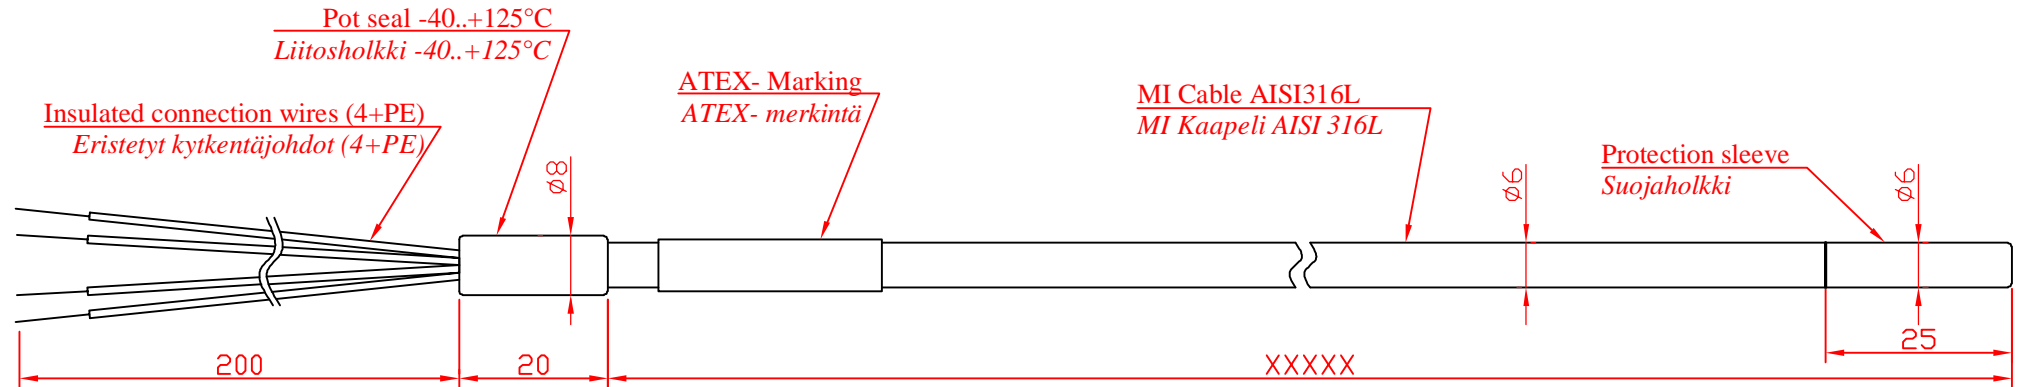

- Operating temperature range -60...+ 450°C temporarily + 550°C
- Max measurin current 10 mA
- Electrical connections to approved unit according to application or to terminal box according to requirements at connecting site
- When 2 or 3 wire connection is used all wires must be connected or terminated accordance with the regulations
- Tinned copper connection wires 0,22 mm<sup>2</sup>

- Käyttölämpötila-alue -60...+ 450°C hetkellisesti + 550°C
- Maksimi mittausvirta 10 mA
- Sähköinen kytkentä sovelluksen mukaisesti hyväksytyyn laitteeseen tai kytkentäkoteloon kytkentä paikan vaatimusten mukaistesti
- Käytettäessä 2- tai 3 johdinkytkentää, kaikki johtimet pitää olla kytkettynä tai päätettynä määräysten mukaisesti
- Tinatut kupari kytkentäjohtimet 0,22 mm<sup>2</sup>

1x Pt100, Class A, 4-wire,  
 acc. to standard IEC 60751.  
 1xPt100, Luokka A, 4-johdin,  
 standardin IEC 60751 mukaan

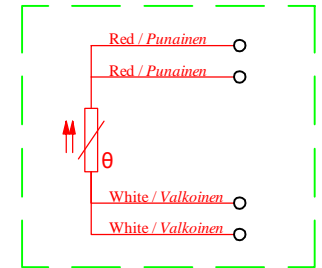

	Name Nimi	Signature Allekirjoitus	Date Päiväys	Info	
Drawn Piirtäjä	J.Mikkonen		18.01.2019	EESF 18 ATEX 049X II 2 G Ex e II T1-T6 II 2 D Ex tD A21 IP66 T 60°C Tamb -40...+125/550°C	Size Koko A4
Checked Tarkastaja	S.Ojanen		18.01.2019		
Approved Hyväksyjä	V.Tepponen		18.01.2019		
<b>LAPP AUTOMAATIO</b> Lapp Automaatio Oy Martinkyläntie 52 FI-01720 Vantaa, Finland p. +358 (0) 20 764 64 e. info.automaatio@lappgroup.com		Process material Prosessi materiaali AISI 316	Product Tuotenimi WT-MI-302-6/XXXXX-200/FEP-4J-KLA-EX		Rev. 3
		Coating material Pinnoite materiaali	Drawing number Piirustusnumero 1068685	Scale Suhde	

## EU Declaration of Conformity

We, the manufacturer Lapp Automaatio Oy  
Martinkyläntie 52  
FI-01720 Vantaa, Finland

declare that the following product

Temperature sensor

Type: WT-MI-302-6/....-200/FEP-4J-KLA-EX


is in conformity with the Directive 2014/34/EU.

The declaration is based on the EU-type Examination Certificate  
EESF 18 ATEX 049X Issue 1

and the Production Quality Assessment Notification EESF 18 ATEX Q 006

issued by Eurofins Expert Services Oy (Notified Body number 0537),  
address: Kivimiehentie 4, P.O. Box 47, FI-02151 Espoo, Finland.

The marking of the equipment or protective system include the following:

 II 2 GD      Ex e II T1-T6  
Ex tD A21 IP66 T60°C  
Tamb -40 ... +125/550°C

The compliance with the Essential Health and Safety Requirements of the Directive is met by  
the compliance with the following standards:

EN 60079-0 (2012)  
EN 60079-7 (2015)  
EN 60079-31 (2014)

“The revised (now harmonized) standards have been compared to the standards used for  
certification purposes and that no changes in the “state of the art” apply to the equipment.”

Vantaa 28.2.2019

  
Johan Olofsson  
Managing Director of Lapp Automaatio Oy

Lapp Automaatio Oy  
Martinkyläntie 52  
FI-01721 Vantaa  
P: +358 (0)20 764 64  
F: +358 (0)20 764 6820  
Email: info.automaatio@lappgroup.com  
www.lappautomaatio.fi

Tavaraosasto/Warehouse Address  
Varastokatu 10  
FI-05800 Hyvinkää  
P: +358 (0)20 764 64  
F: +358 (0)20 764 8355

Kotipaikka/Domicile  
Vantaa  
Y-tunnus: 1107293-1  
VAT: FI11072931

Lapp Automaatio on osa LAPP Groupia  
A Lapp Group Company  
Lapp Insulator ei ole osa LAPP Groupia  
Lapp Insulator is not affiliated  
with the Lapp Group